


STRUCTURAL STREAMBANK STABILIZATION - GABIONS

2 BASKETS HIGH W/O MAT

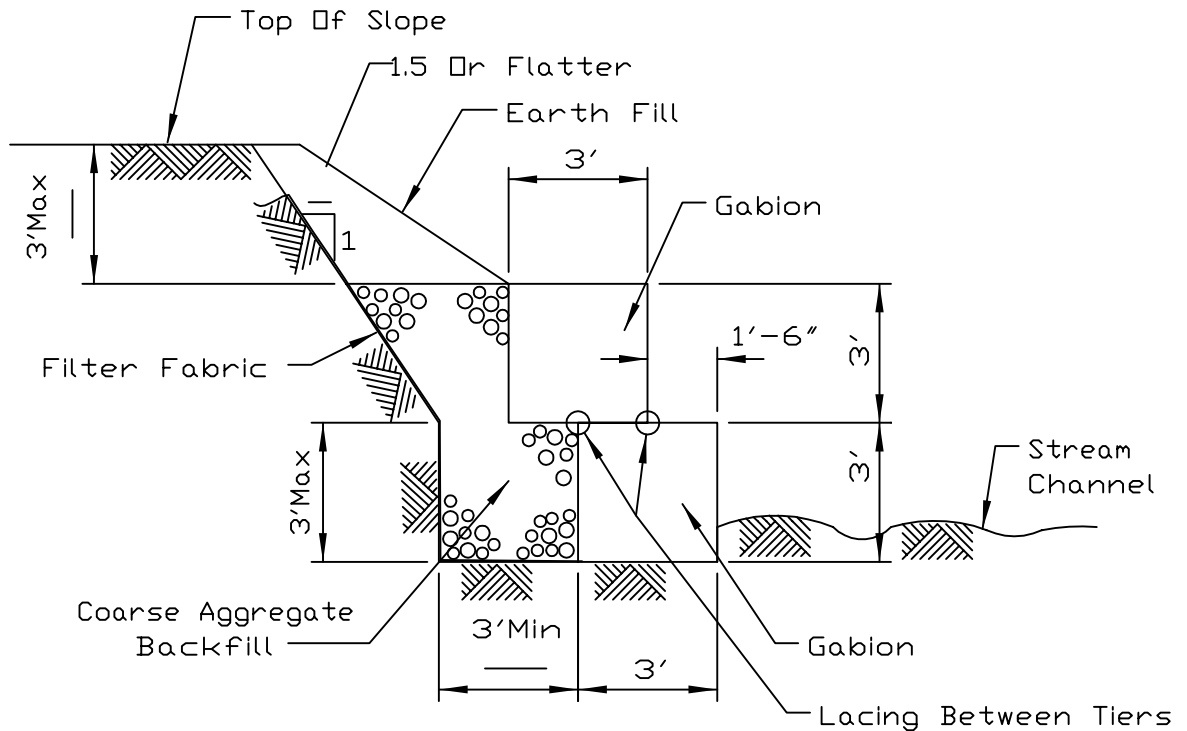

SECTION

NOTES:

1. The filter fabric shall meet the requirements in material specification 592 GEOTEXTILE Table 1 or 2, Class I, II or III.
2. The coarse aggregate backfill shall meet the IDOT requirement for the following gradations CA-1, CA-3 or RR-1.
3. The Gabions shall be installed according to construction specification 64 WIRE MESH GABIONS
4. Baskets which are stacked in tiers shall have vertical seams staggered for each row and tier.
5. The coarse aggregate backfill shall be placed level with the top of the lower basket before the upper basket is installed.

REFERENCE	
Project	_____
Designed	_____ Date _____
Checked	_____ Date _____
Approved	_____ Date _____



STANDARD DWG. NO.
IL-641
SHEET 1 OF 1
DATE 5-16-94